


RIGHTHAND OPERATOR

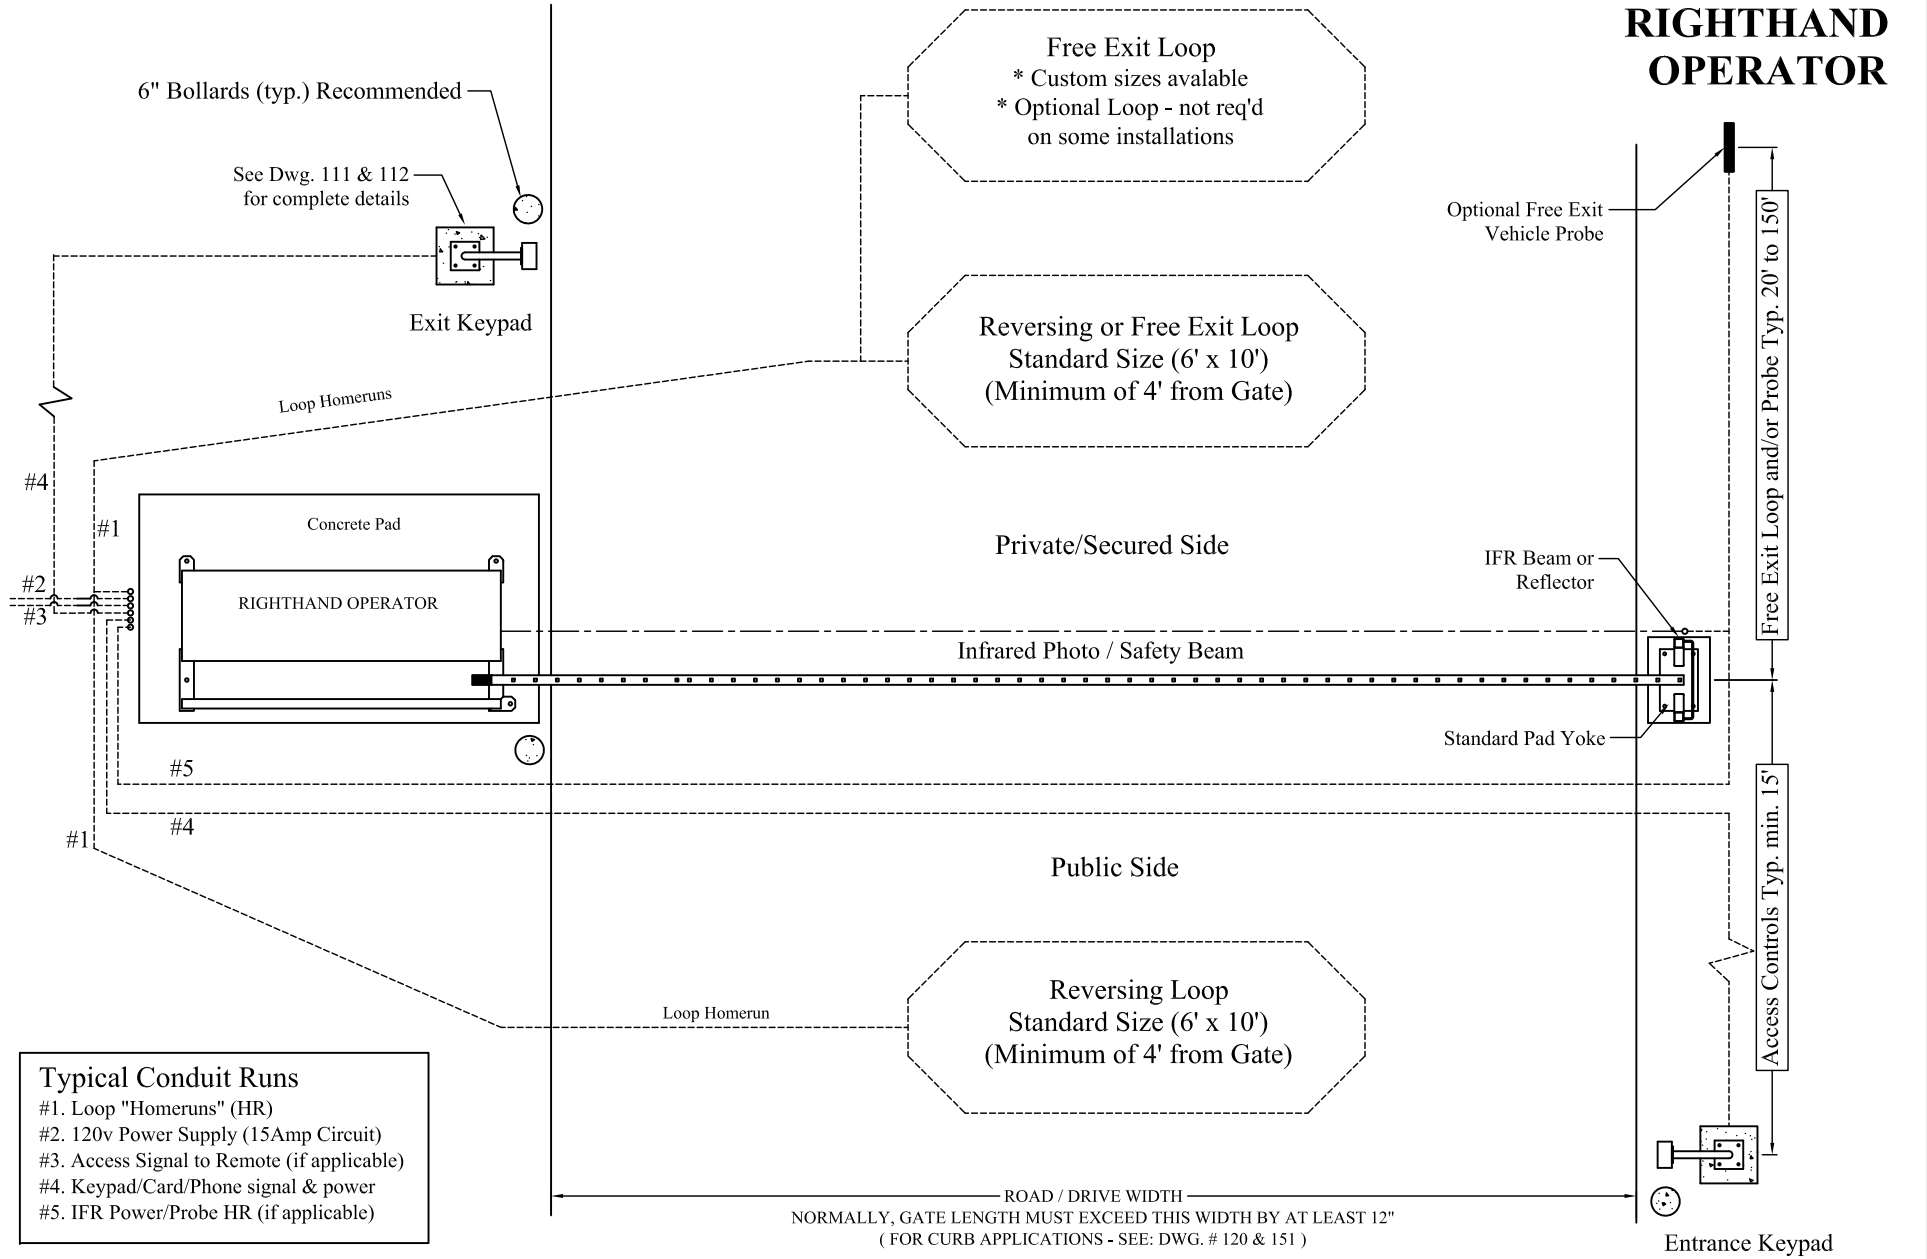

Typical Conduit Runs
 #1. Loop "Homeruns" (HR)
 #2. 120v Power Supply (15Amp Circuit)
 #3. Access Signal to Remote (if applicable)
 #4. Keypad/Card/Phone signal & power
 #5. IFR Power/Probe HR (if applicable)

Free Exit Loop
 * Custom sizes available
 * Optional Loop - not req'd on some installations

Reversing or Free Exit Loop
 Standard Size (6' x 10')
 (Minimum of 4' from Gate)

Reversing Loop
 Standard Size (6' x 10')
 (Minimum of 4' from Gate)

NOTICE
 THE INFORMATION CONTAINED ON THIS DOCUMENT IS CONFIDENTIAL. ANY DISSEMINATION, UNAPPROVED DISCLOSURE OR COPYING OF THIS INFORMATION IS STRICTLY PROHIBITED.
 UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES ± 1°
 X/X ± 1/32, .XX ± .01, .XXX ± .005

Date: 12/20/05
 Dwn. By: MKS
 Supercedes: 7/9/04
 Dwg.: 100-R



DO NOT SCALE

Rev. No.:	Revisions:	Date:

Title: Operator and Accessory Site Layout