



LEFTHAND OPERATOR

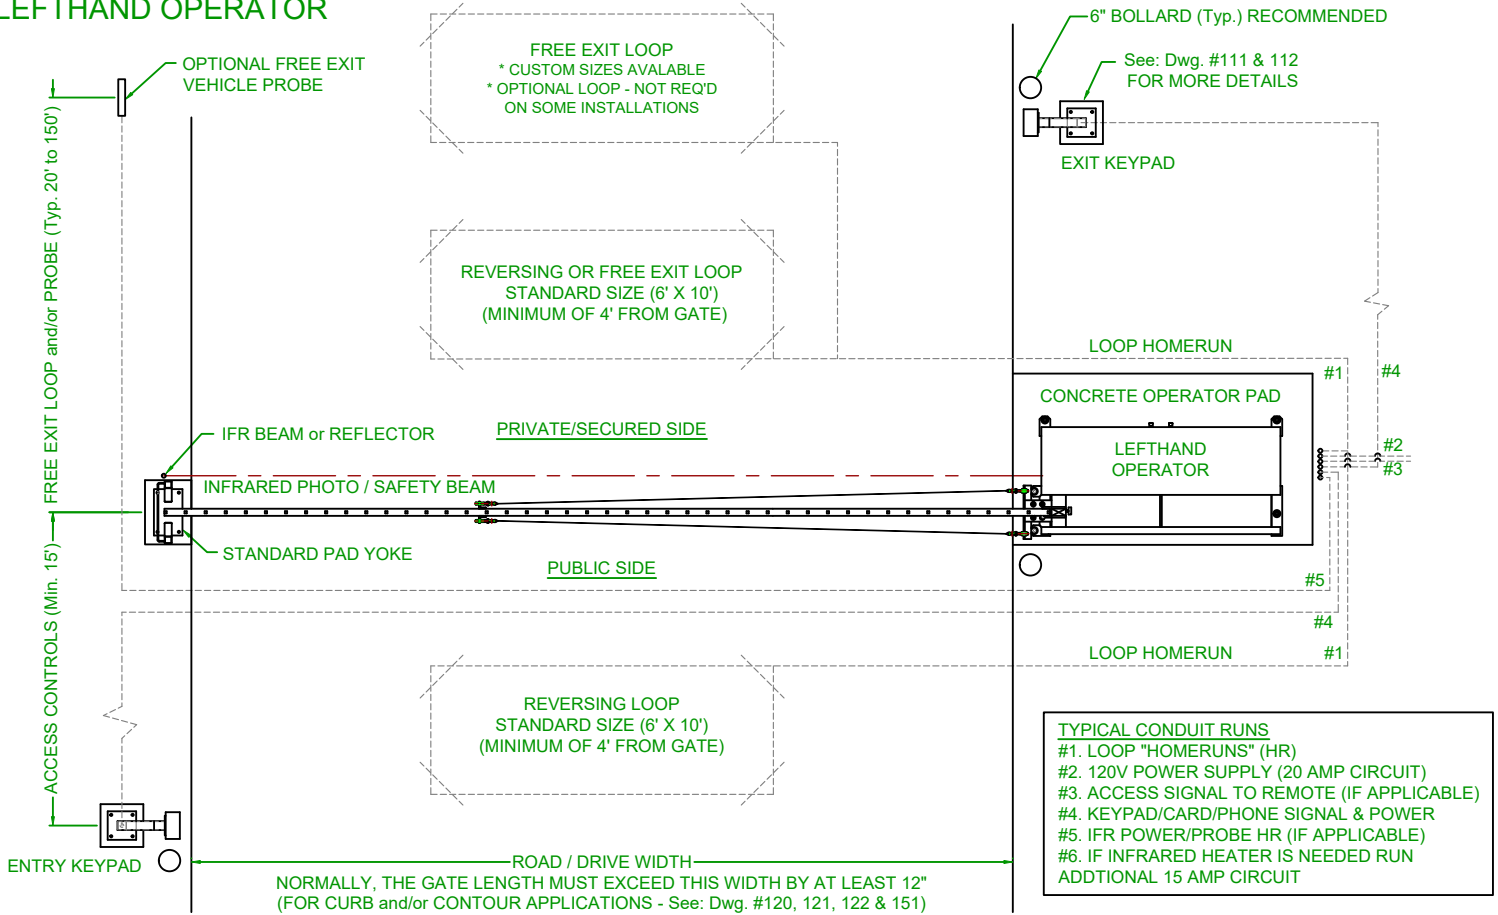

TYPICAL CONDUIT RUNS
 #1. LOOP "HOMERUNS" (HR)
 #2. 120V POWER SUPPLY (20 AMP CIRCUIT)
 #3. ACCESS SIGNAL TO REMOTE (IF APPLICABLE)
 #4. KEYPAD/CARD/PHONE SIGNAL & POWER
 #5. IFR POWER/PROBE HR (IF APPLICABLE)
 #6. IF INFRARED HEATER IS NEEDED RUN ADDITIONAL 15 AMP CIRCUIT

RIGHTHAND OPERATOR

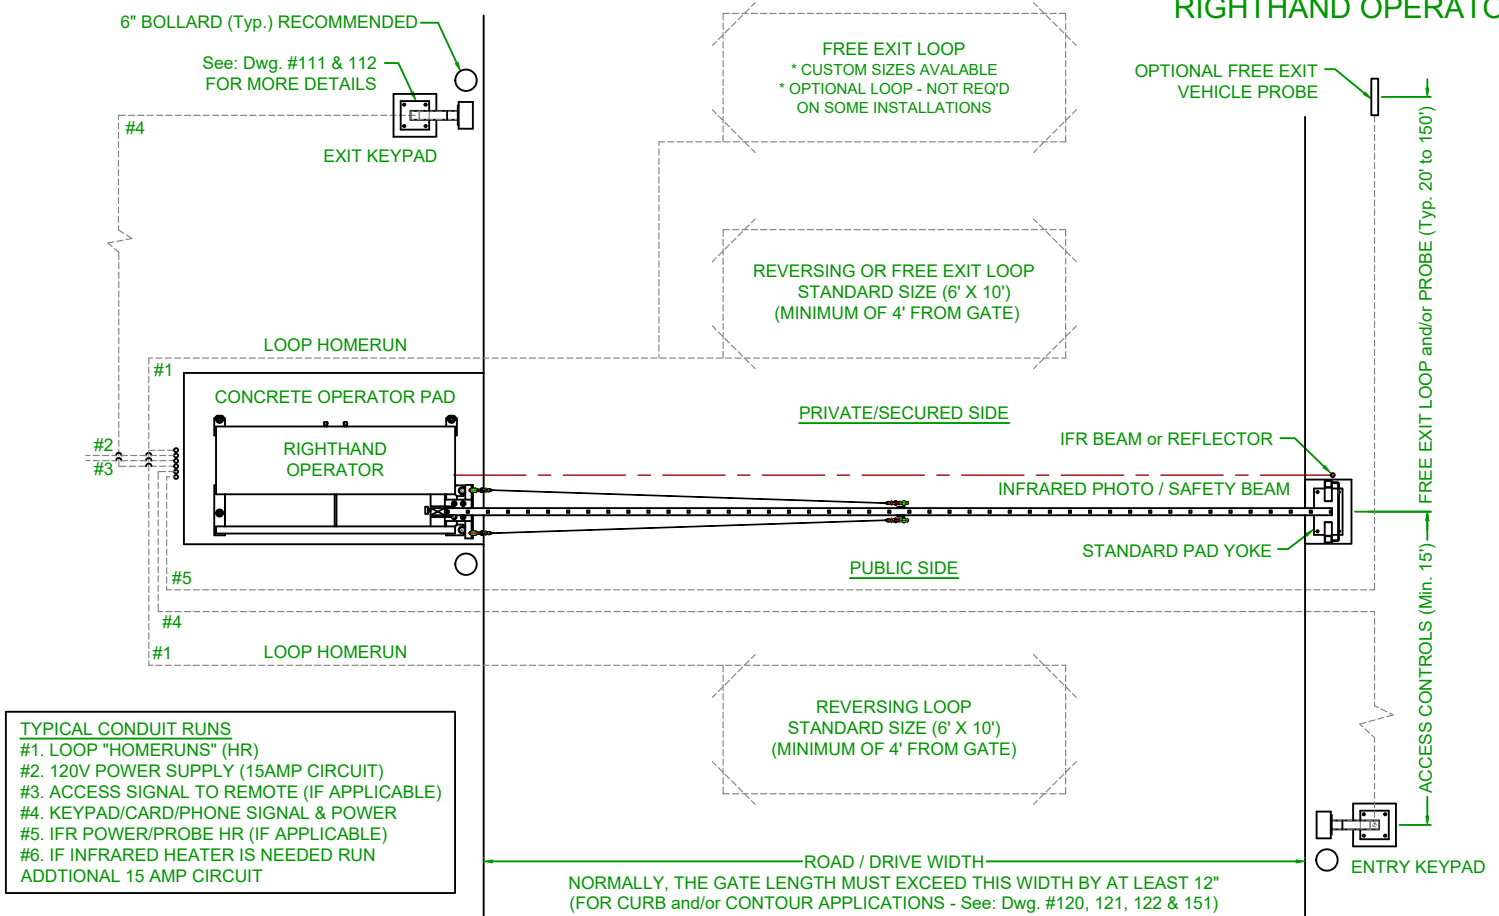

TYPICAL CONDUIT RUNS
 #1. LOOP "HOMERUNS" (HR)
 #2. 120V POWER SUPPLY (15AMP CIRCUIT)
 #3. ACCESS SIGNAL TO REMOTE (IF APPLICABLE)
 #4. KEYPAD/CARD/PHONE SIGNAL & POWER
 #5. IFR POWER/PROBE HR (IF APPLICABLE)
 #6. IF INFRARED HEATER IS NEEDED RUN ADDITIONAL 15 AMP CIRCUIT

NOTICE
 THE INFORMATION CONTAINED ON THIS DOCUMENT IS CONFIDENTIAL. ANY DISSEMINATION, UNAPPROVED DISCLOSURE OR COPYING OF THIS INFORMATION IS STRICTLY PROHIBITED.
 UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES
 ANGLES ± 1°
 XX ± 1/32, .XX ± .01, .XXX ± .005

Date: 07/21/16
 Dr. By: MKS
 Ckd. By: KAY



Rev.:	Description:	Date:	Drn. By:	Ckd. By:

Dwg.: 100 Operator & Accessory Site Layouts (LH & RH)
 Title: 100 Operator & Accessory Site Layouts (LH & RH)